



TYPICAL TRENCHBOX CONFIGURATION

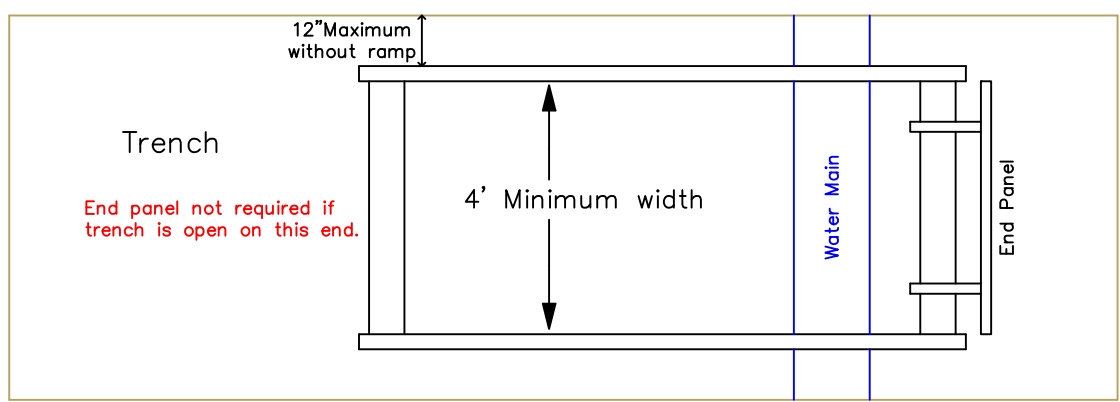

Overhead View

- *Minimum of 12" between trench walls and sides of trench box or else access ramp is required.
- *Must have ladder in trench box that extends a minimum of 3' above trench box.
- *If trench box does not have legs, it CANNOT rest on the water main.

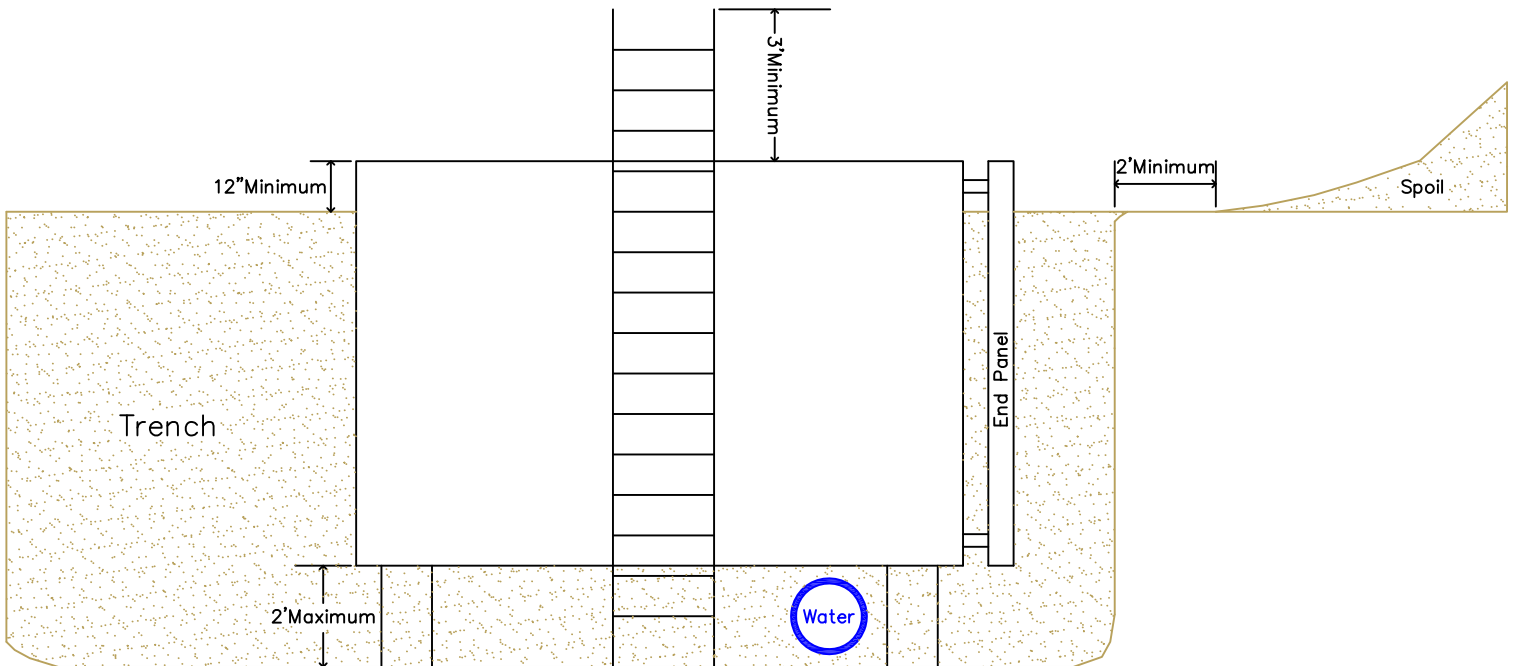

MISSOULA WATER

1345 W. Broadway
 PO Box 4826
 Missoula, MT 59806
 Ph: 406-552-6700
 Fx: 406-327-2170

TYPICAL TRENCH BOX
 CONFIGURATION

REVISED DATE: 7/19/17

WSD-5