


NOTE: RESTRAINED JOINTS WITHIN 36 FEET OF VALVE WITH MEGALUGS, FIELD LOK GASKETS, OR APPROVED EQUIVALENT.



GENERAL NOTES:

- CONSTRUCTION MATERIALS AND PROCEDURES SHALL COMPLY WITH MONTANA PUBLIC WORKS STANDARD SPECIFICATIONS (MPWSS), 7TH EDITION, APRIL 2021, AS MODIFIED BY THE MISSOULA CITY PUBLIC WORKS STANDARDS AND SPECIFICATIONS MANUAL, APPENDIX 2-A (STANDARD MODIFICATIONS TO MPWSS), CURRENT EDITION.

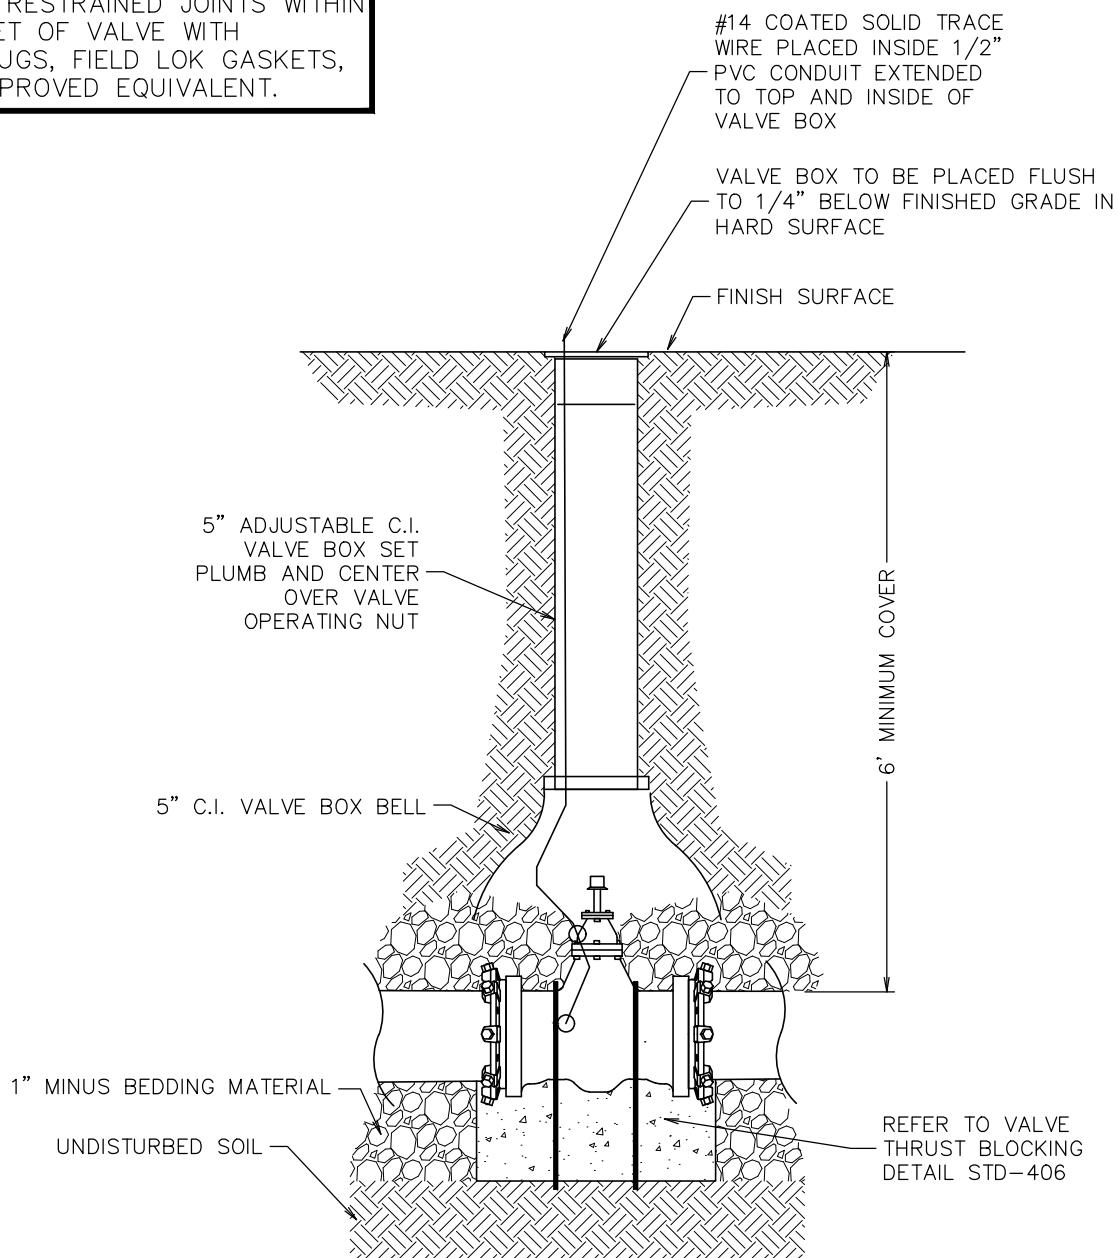

Engineering Division

Valve Detail

Logan McInnis

Approved By
Utilities Engineer
Logan McInnis, PE

Adopted: 09/28/2020
Revised: 01/01/2023

STD - 405